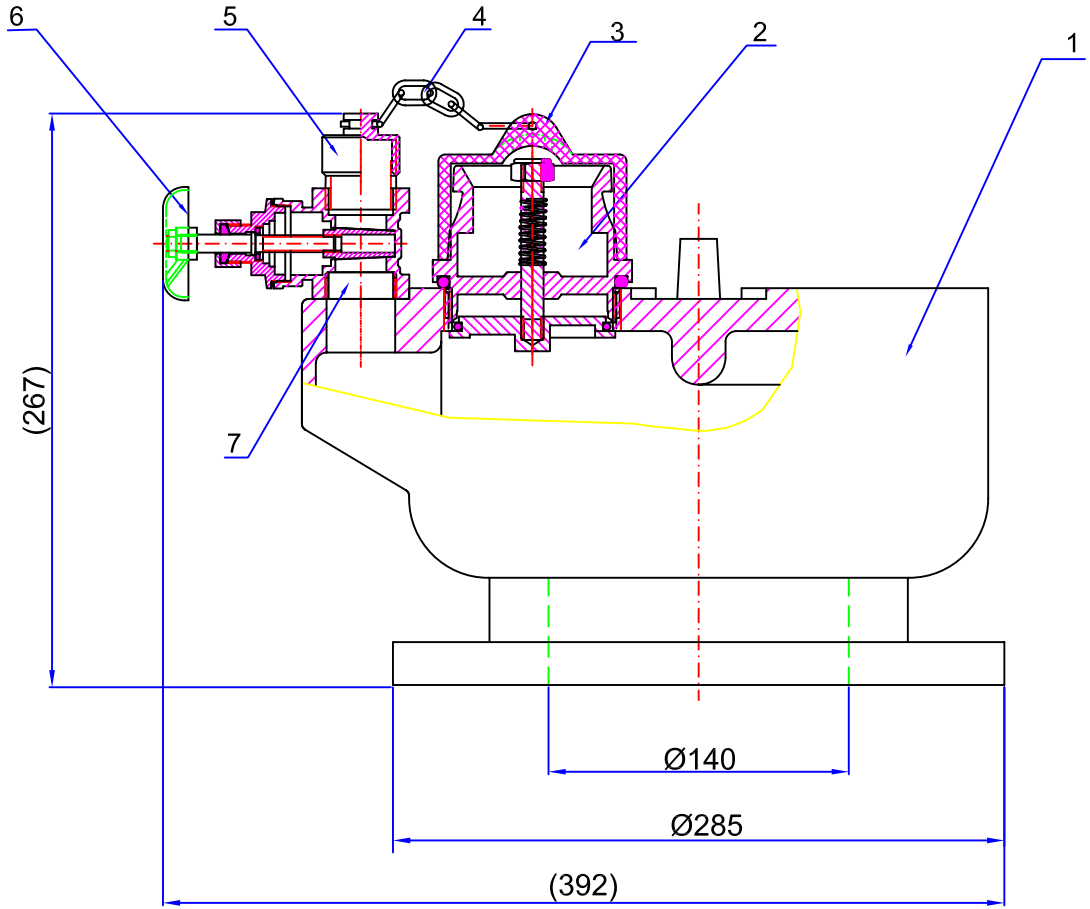

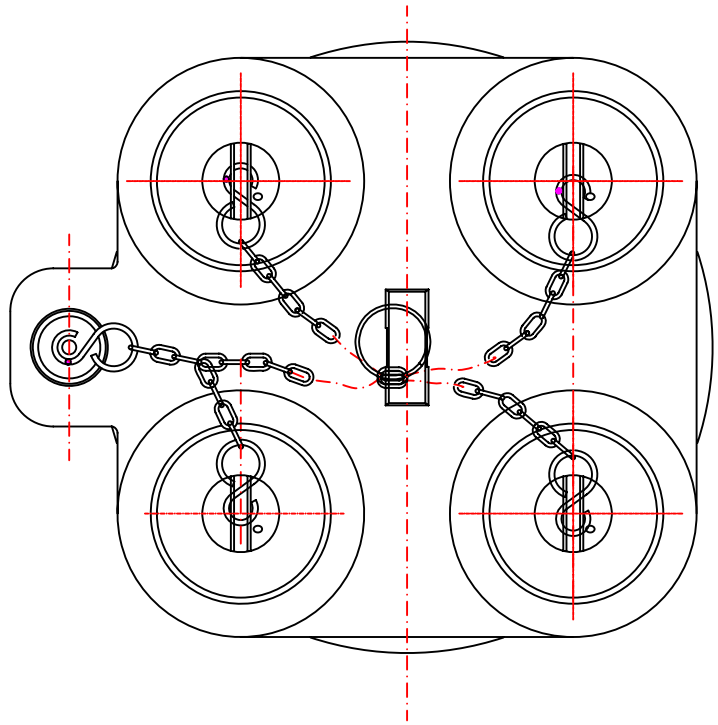

Technical requirements:

1. When 1" joint is connected with valve body and 1" gate valve, it shall be sealed with thread sealant;
2. There shall be without leakage, destruction and eternal deformation after tested at water pressure of 20bar;
3. Inlet flange at the bottom is DN150, per standard BS4504(PN16).

No.	Drawing No.	Name	Q'TY	Material	Weight	Remark
7	DLS01-064-06	1"Joint	2	Steel(Nickel Plating)		
6	DLV05-002-00	1"Gate valve	1	Assembly		
5	DLS01-064-05	Aluminium cap	1	6061		
4	DLS01-064-04	Chain	1	SUS 304		
3	DLS01-064-03	Cap	4	Rubber		
2	DLS01-064-02-00	Connecting seat	4	Assembly		
1	DLS01-065-01	Valve body	1	Ductile iron		

Zone	Revision note	Date	Signature

Drawn		Audit	
Checked		Approved	

Four Way Inlet Breeching Valve(BS4504)

Code No. HV009

Assembly

W.T. ~34.46Kg | Scale

Hydrotech